


TYPICAL HYDRANT INSTALLATION

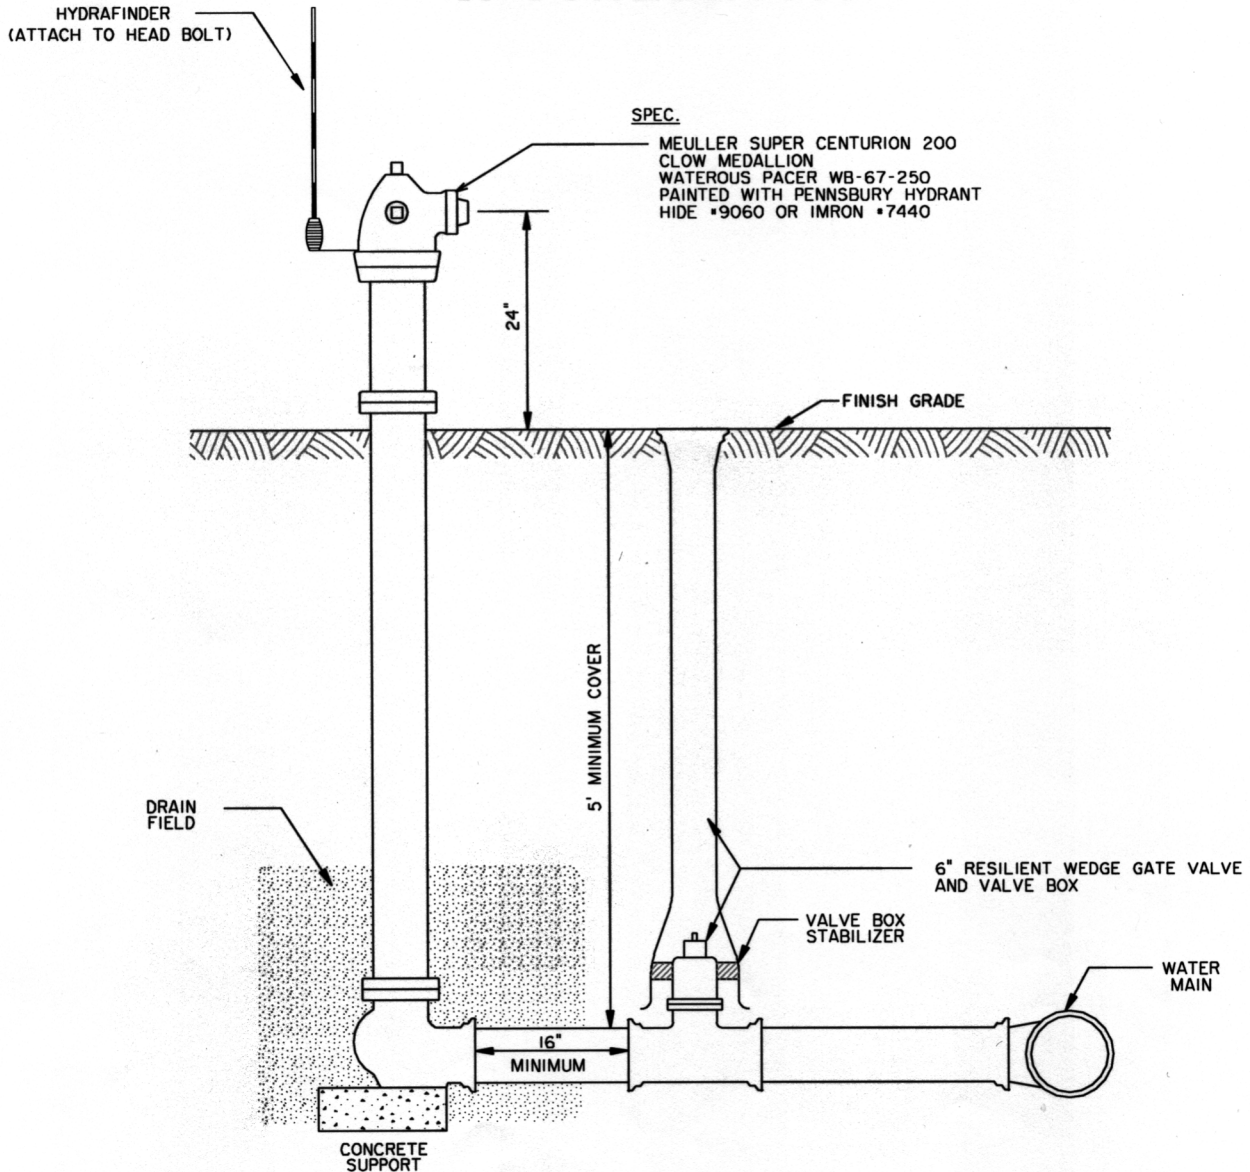

NOTES:

- 1.) THE NOZZELS SHALL NOT BE CLOSER THAN 2 FEET FROM BACK OF CURB OR SIDEWALK.
- 2.) ALL JOINTS FROM THE HYDRANT TO THE MAIN SHALL BE RESTRAINED WITH MEGA-LUG OR UNI-FLANGE RESTRAINING DEVICE OR APPROVED EQUAL IN ACCORDANCE WITH THE CITY CODE OR TIE THE AUXILIARY VALVE TO THE TEE AND THE HYDRANT TO THE AUXILIARY VALVE WITH MINIMUM $\frac{3}{4}$ " STAINLESS STEEL RODS, NUTS AND WASHERS
- 3.) ALL BELOW GRADE FACTORY INSTALLED BOLTS SHALL BE STAINLESS STEEL GRADE 304
- 4.) HYDRANTS MAY ONLY HAVE ONE (1) EXTENSION KIT.

CITY OF ST. CHARLES